
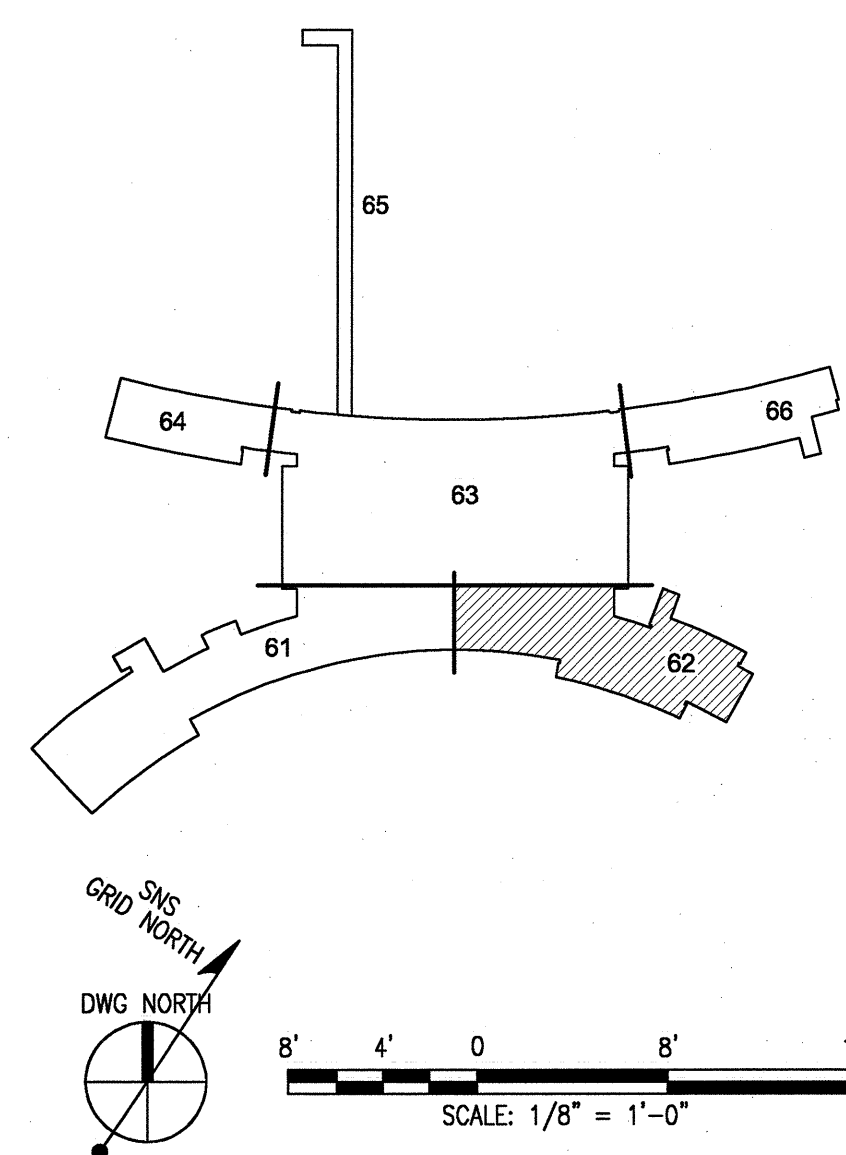


GENERAL NOTES:


1. SEE DRAWINGS E9.21.52 AND E9.21.53 FOR LIGHTING PANEL SCHEDULES.
2. SEE DRAWINGS E9.30.01 AND E9.30.02 FOR FIXTURE SCHEDULES.

KEYED NOTES:

- N001] ALL NORMAL LIGHTING FIXTURES ON THIS DRAWING ARE CIRCLED FROM PANEL 4L2A LOCATED IN ELECTRICAL ROOM 4-1-41.
- N002] ALL EMERGENCY LIGHTING FIXTURES AND EXIT SIGNS ON THIS DRAWING ARE CIRCLED FROM PANEL 3E5A LOCATED IN ELECTRICAL ROOM 3-2-65. LIGHTING IN STAIR NO. 1 TO BE CIRCLED FROM PANEL 3E5A IN ELECTRICAL ROOM 3-1-2-31.
- N003] ALL FIXTURES ARE MOUNTED 9'-5" A.F.F. UNLESS OTHERWISE NOTED.
- N004] CORRIDOR FIXTURES (W1) ARE MOUNTED 8'-0" A.F.F.

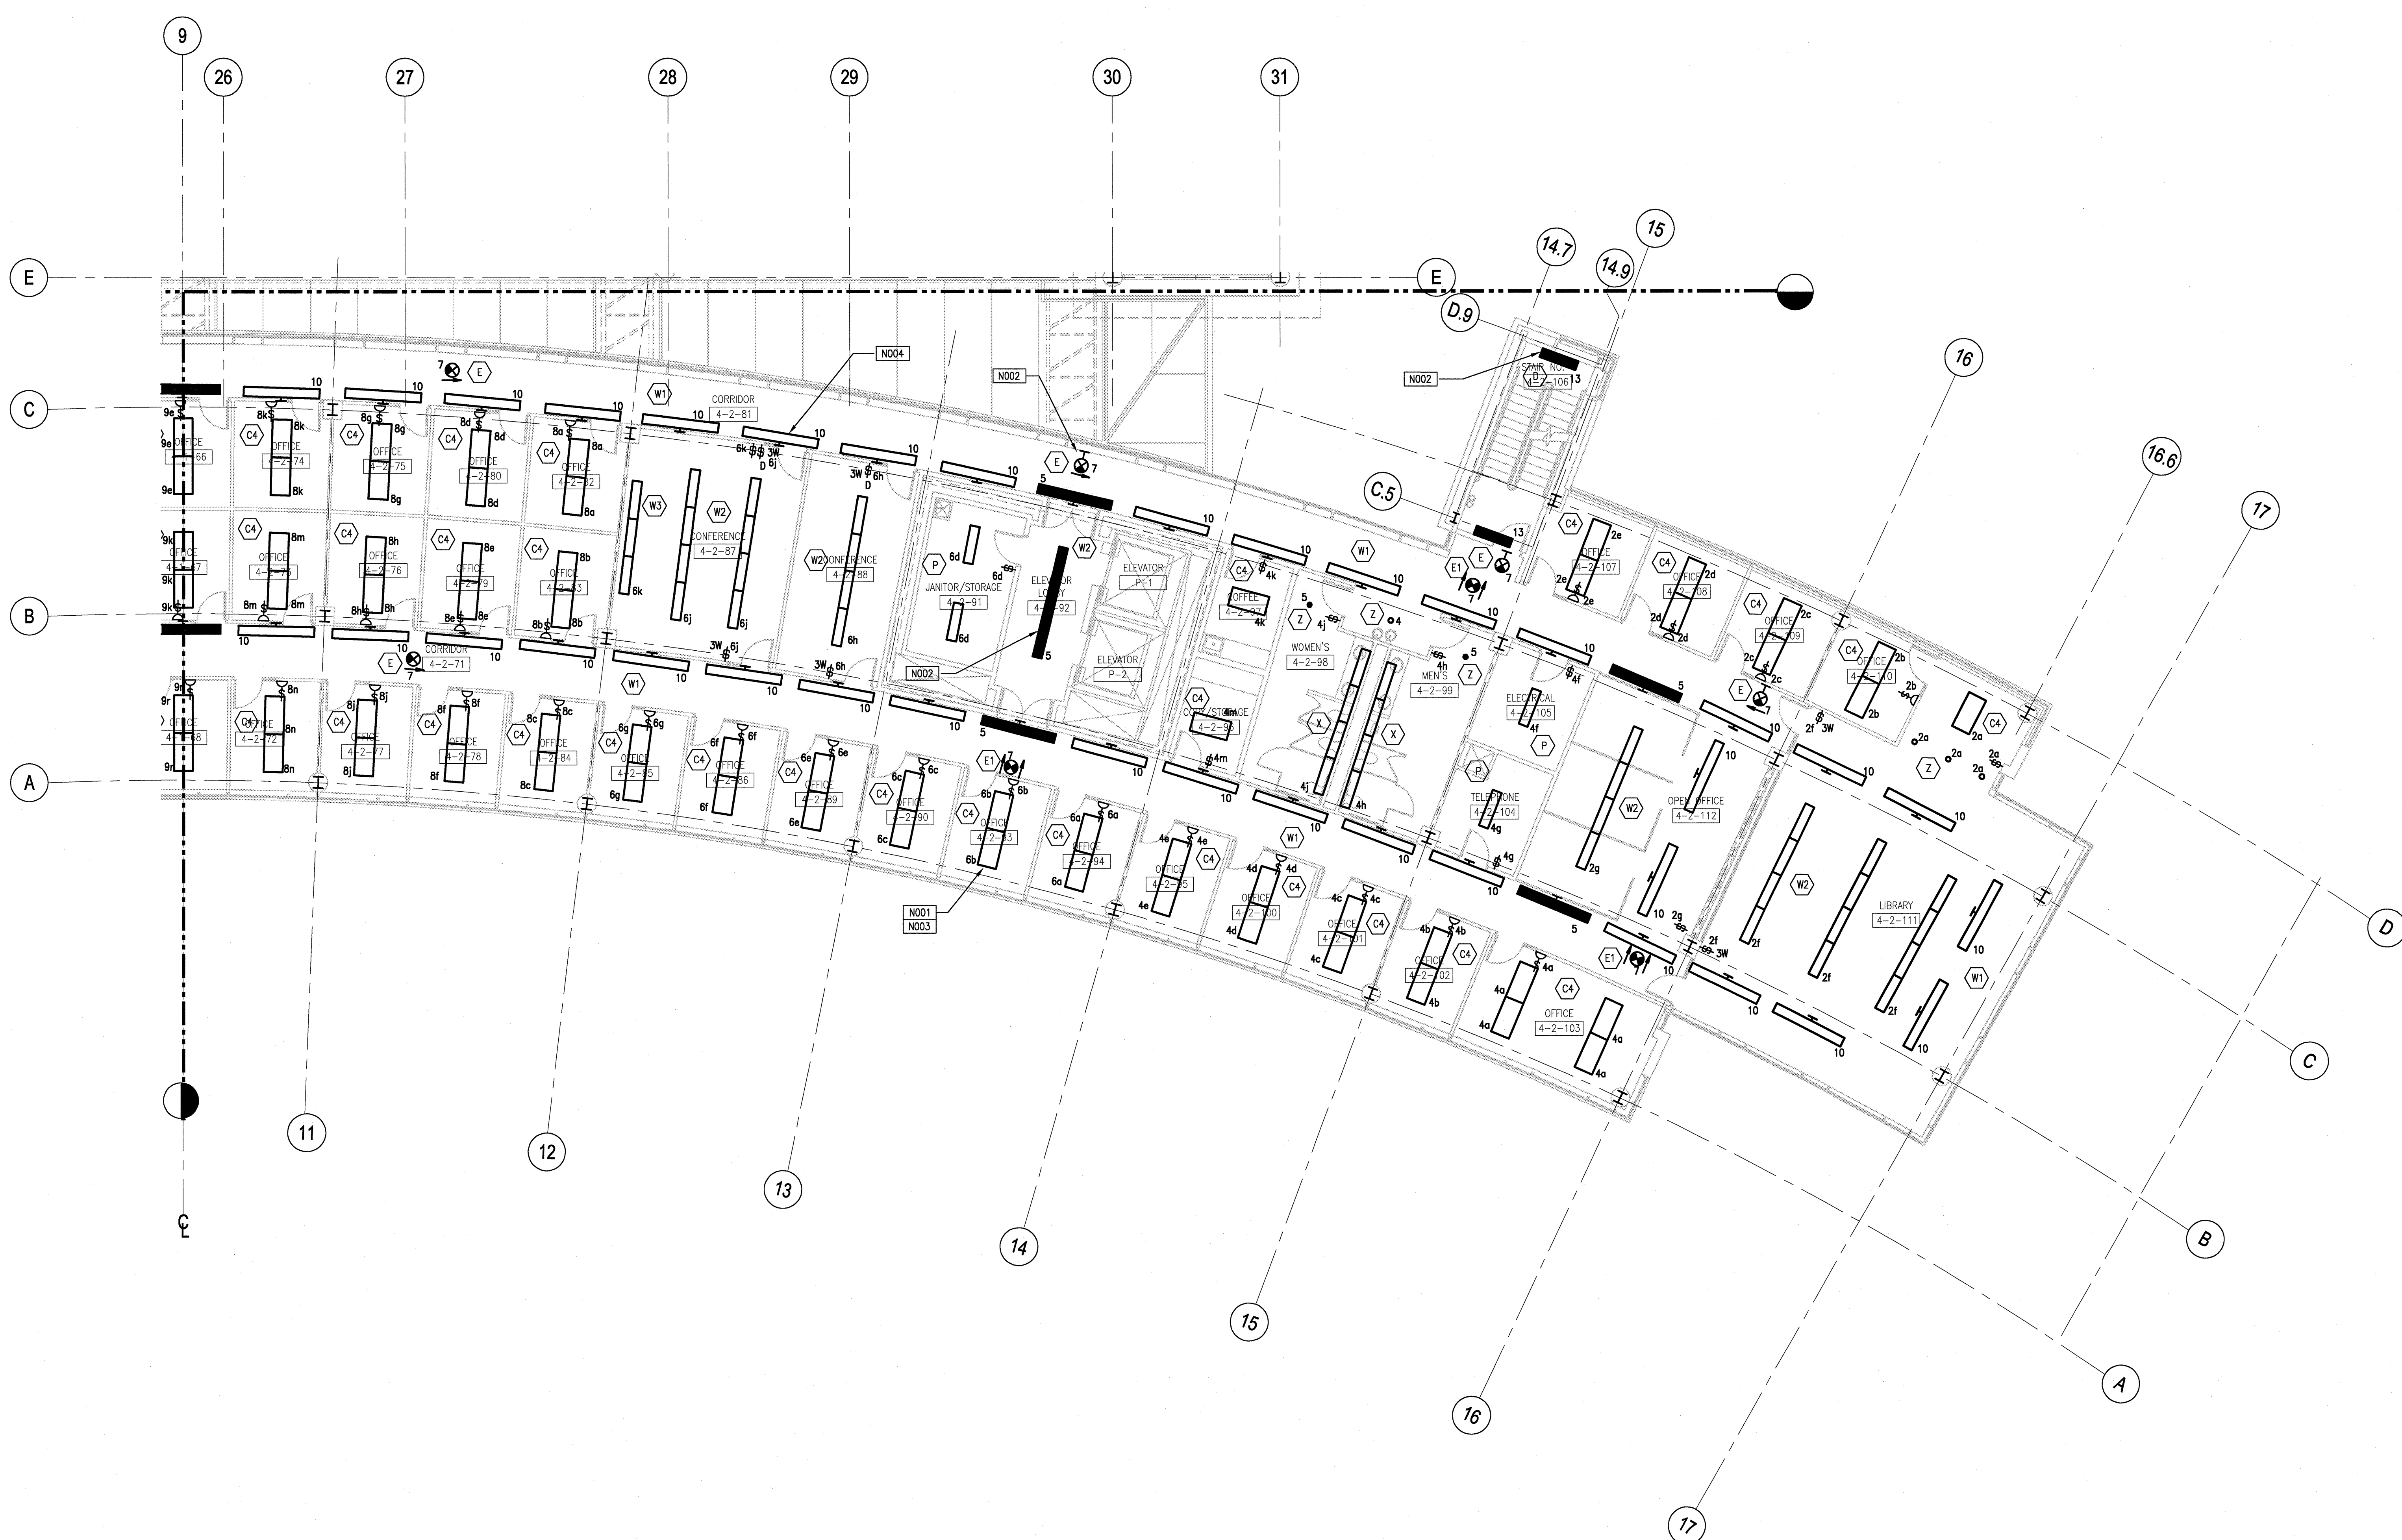

108031400-E8E-8600-A035

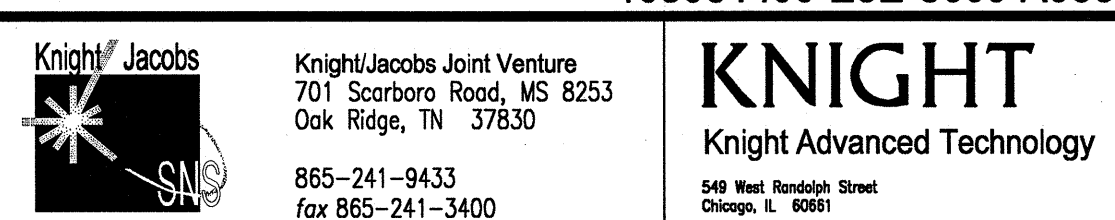


Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725
UT-BATTELLE, LLC, a Oak Ridge, Tennessee

PROJECT NAME:
**SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
ELECTRICAL LIGHTING PLAN
LEVEL 04, SECTOR 62**

REV	DATE	BY	CHK	DESCRIPTION	CLASS
1	4/8	X	X	PLANT	8
3	E	X	X	BLDG	8600
5	NC	NA	53	WBS	1.8.3.14

E3.04.62

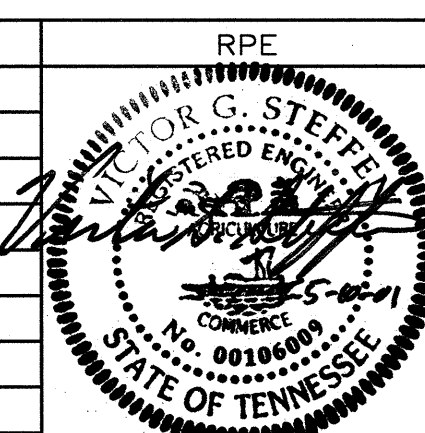

DSN	C.SAPALA	5/15/01
DRW	C.SAPALA	5/15/01
CHK	K.SZOT	5/15/01
DEPT		
PE		
P.J.		
REQ		

REV. DATE 5-10-01

REV	DATE	BY	CHK	DESCRIPTION	CLASS
1	4/8	X	X	PLANT	8
3	E	X	X	BLDG	8600
5	NC	NA	53	WBS	1.8.3.14

E3.04.62

SECTION AND DETAIL KEY

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM

ENGINEERING PROCEDURE SNS-ENG-0001

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.